


Schematic diagram (air flow routing)

1.

- 1 Upper part of air cleaner housing
- 2 Intake air temperature sensor
- 3 Air intake pipe
- 4 Hose clamps
- 5 Air intake hose
- 6 Lower part of air cleaner housing

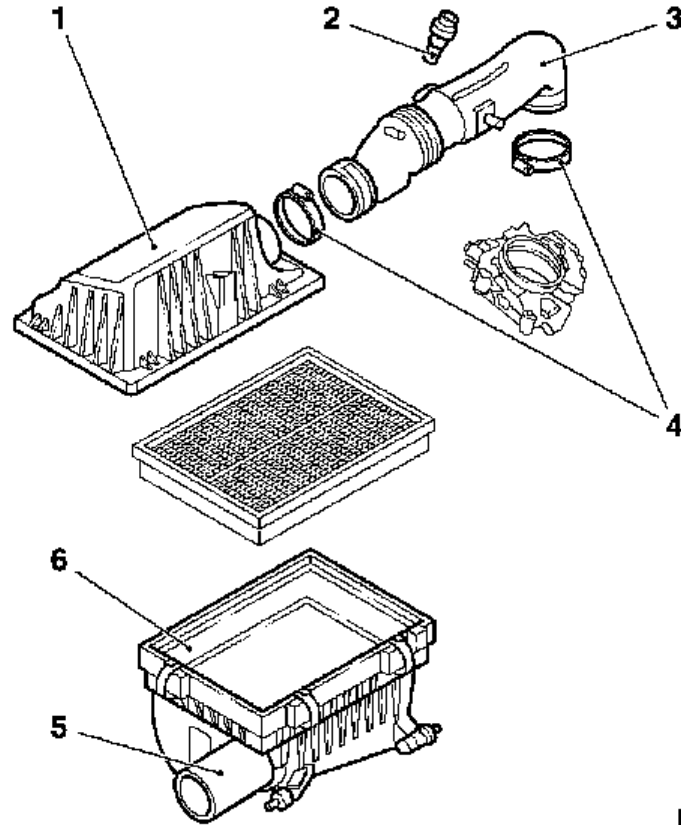

L0008720

Important: Prior to installation, clean any contamination (grease, oil etc.) from the air intake pipe and the connection pieces.

2. When tightening the hose clamps, carefully ensure that the tightening torque of **3,5 Nm** is adhered to.

Note: It can only be guaranteed that the intake system is leak-free and will thus operate safely and reliably if the hose clamps are tightened to the specified tightening torque.